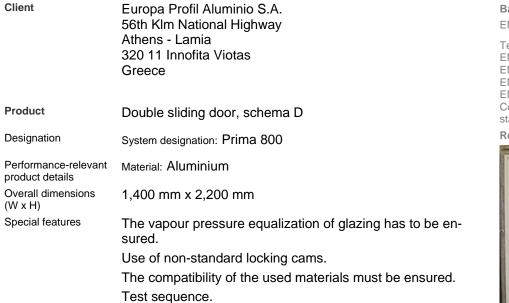# Evidence of Performance

Resistance to wind load, Watertightness, Air permeability, Operating forces

Test Report
No. 13-002207-PR01
(PB-A01-02-en-01)

Client	Europa Profil Aluminio S.A. 56th Klm National Highway Athens - Lamia 320 11 Innofita Viotas Greece
Product	Double sliding door, schema D
Designation	System designation: **Prima 800**
Performance-relevant product details	Material: **Aluminium**
Overall dimensions (W x H)	1,400 mm x 2,200 mm
Special features	The vapour pressure equalization of glazing has to be ensured. Use of non-standard locking cams. The compatibility of the used materials must be ensured. Test sequence.

Basis

EN 14351-1:2006+A1:2010

Test standard/s:
EN 1026:2000-06
EN 1027:2000-06
EN 12046-1:2003-11
EN 12211:2000-06
Correspond/s to the national standard/s (e. g. DIN EN)

Representation

Instructions for use

The results obtained can be used by the manufacturer as the basis for the manufacturer ITT test report summary. Observe the specifications set out by the applicable product standard.

Validity

The data and results refer solely to the tested and described specimen. Classification remains valid as long as the product and the above basis remain unchanged. The results can be extrapolated under the manufacturer's own liability subject to observance of the relevant specifications set out by the applicable product standard. This test/evaluation does not allow any statement to be made on any further characteristics regarding performance and quality of the construction presented; in particular the effects of weathering and ageing were not taken into account.

Notes on publication

The **ift**-Guidance Sheet "Advertising with ift test documents" applies. The cover sheet can be used as an abstract.

The report contains a total of 27 pages.

Results

Air permeability according to EN 12207:1999-11

Class 3

Watertightness according to EN 12208:1999-11

Class 4A

Resistance to wind load
according to EN 12210:1999-11/AC:2002-08

Class C2 / B3

ift Rosenheim
23.09.2013

Robert Kolacny, Dipl.-Ing. (FH)
Deputy Head of Testing Department
Building Components

Thomas Krichbaumer
Operating Testing Officer
Tightness & Wind Load